

APPENDIX II

SANITARY SEWER LATERAL AND SANITARY SEWER CONNECTION

Before you Dig - Pennsylvania Act 187, Underground Utility Line Protection Law of 1996
Requires You Call Pennsylvania One Call 1-800-242-1776



1. General – Sanitary sewer lateral shall include connection to the public sewer, sight tee, test tee, clean-outs, running trap with fresh air vent, a grease trap where required, and connection to the building drain. Down-spouts, rain conductors, driveway drains, area drains, or french drains shall not be connected to the sanitary sewer lateral.
2. Size - Residential - 4" minimum diameter pipe that is installed to a minimum slope of 1/4" per foot. Non-Residential - 6" minimum diameter pipe that is installed to a minimum slope of 1/8" per foot.
3. Materials – The sanitary sewer lateral shall be Schedule 40 solid core PVC, except in the case of 6" pipe that may be SDR 35 or Schedule 40 solid core PVC. A running trap the same size as the sanitary sewer lateral with a vent pipe and plastic mushroom vent cap shall be installed no less than two (2) and no more than five (5) feet from the outer face of the outside wall. The pipe as it exits the building wall shall be installed at a minimum depth of 48". Vent pipes and clean-outs are not permitted to be located in driveways, carpaths, walkways or other finished surface areas unless prior approval is granted by the Authority. The vent cap shall be installed 6" above grade to prevent the inflow of water into the sanitary sewer lateral.

Food preparation establishments and other establishments at the discretion of the Authority shall install grease traps of a style and size acceptable to the Authority. Sinks in food preparation areas of these establishments shall also have under-sink grease traps.
4. Clean-Outs and Directional Changes - Clean-outs, consisting of a wye branch fitting, a curved fitting, riser pipe and a watertight cap are required every 100 feet or at all directional changes greater than 45 degrees. No 90 degree bends shall be permitted. No exceptions.
5. Adapters - Approved adapters as manufactured by Fernco, Inc., or approved equivalent, may be used to connect pipe joints, reduce 6" pipe to 4" and connect the building drain to the running trap. All adapters shall be stainless steel shielded couplings with stainless steel clamps or must be encased in concrete.
6. Installation - Before digging the trench, the installer should expose the sanitary sewer connection and the building drain. Trench width shall be kept to a minimum width and have uniform slope as near as possible at right angles to the street. Excavate all trenches

at least 6" below the bottom of the pipe. Place an aggregate backfill, maximum of 3/4" gravel size (2B), in the trench to grade of the pipe. Install the pipe keeping any gravel, dirt or water from entering the pipe. Place 12" of 2B stone aggregate on top of the pipe ensuring uniform bedding to all sides of the pipe. The remainder of the trench may be backfilled with material from the original excavation. Any part of the trench that crosses a traffic area must be filled to the level of the existing grade with aggregate such as 1A modified. The sanitary sewer lateral trench shall have a minimum 3 feet horizontal separation and 18" vertical separation from other pipelines such as water service lines, gas lines, french drains or storm sewers. An Authority inspector must be present to visually inspect the backfilling of the sanitary sewer lateral trench.

7. Inspection - The Authority shall be notified at least 24 hours prior to the inspection of the building drain, sanitary sewer lateral and related appurtenances. The inspection shall be conducted prior to the connection to the trap, unless the building drain and the sanitary sewer lateral are to be inspected at the same date, and prior to any backfilling. All lines shall be capped prior to inspection. The inspection shall consist of an air test of 5 lbs. for 5 minutes without any loss of pressure, or a hydrostatic test where no water is lost from a filled sanitary sewer lateral for 5 minutes, a visual inspection of the pipe and the recording of pertinent information relating to the installation of the pipe. Inspection will not be scheduled until all Applications for Service have been submitted. If the sewer lines do not pass inspection, a fee will be levied and must be paid before re-inspection of the sanitary sewer lateral will be scheduled.
8. Final Connection - If a completed connection to the building drain is not made at the time of the installation of the sanitary sewer lateral, a temporary plug shall be solvent welded into the end of the lateral and shall not be removed until such time as the connection is made to the building drain and an Authority Representative is present to visually inspect the final connection and backfilling of the trench.
9. Final Inspection - Prior to the issuance of an Occupancy Permit by Rostraver Township, the Authority will conduct a final inspection of the property to ensure that all sewer facilities located within the property have been installed and maintained in accordance with Authority specifications. The Authority's inspector will complete and sign a Final Inspection Form to be forwarded to Rostraver Township for their subsequent issuance of the Occupancy Permit. Any deficiencies cited during the Final Inspection must be corrected prior to the Authority's release of the Final Inspection Form to Rostraver Township.
10. Grinder Pumps - Grinder pumps for individual sewer service to private properties are used only when gravity service is not available or is not a viable option. The recommended grinder pump for this type of service is the E/One Extreme Grinder Pump, Model DH071, as manufactured by Environment One Corporation. The Authority will accept all maintenance responsibilities for E/One grinder pumps pursuant to the homeowner entering into a service agreement with the Authority. The installation of all pumps and their operation, maintenance (if not an E/One grinder), and power costs are not the responsibility of the Authority, but that of the property owner.

11. Pressure Sewer Pipe 2 be SDR-21 and shall 1 Pressure pipe smaller compression or hose 1 sewer pipe shall be ex the requirements of AS and have rubber ring se
12. Small Diameter Pressu connection shall be n configuration as the se inch diameter branch c and a check valve an installed with a valve 1 inch diameter similar c 2-inch diameter, Valm approved equal. Valve type, No. 664-5 having the lid. Reference Stan

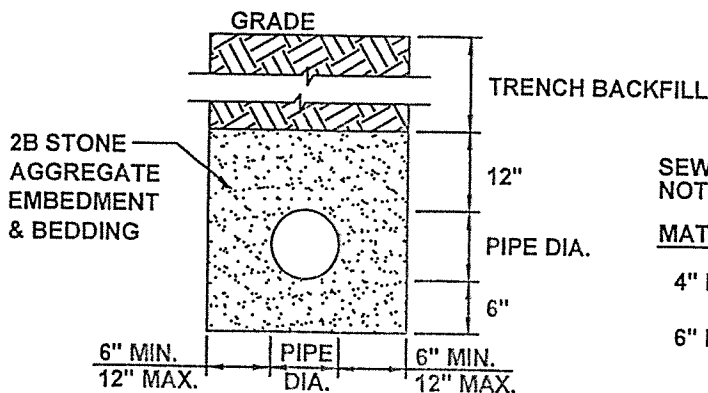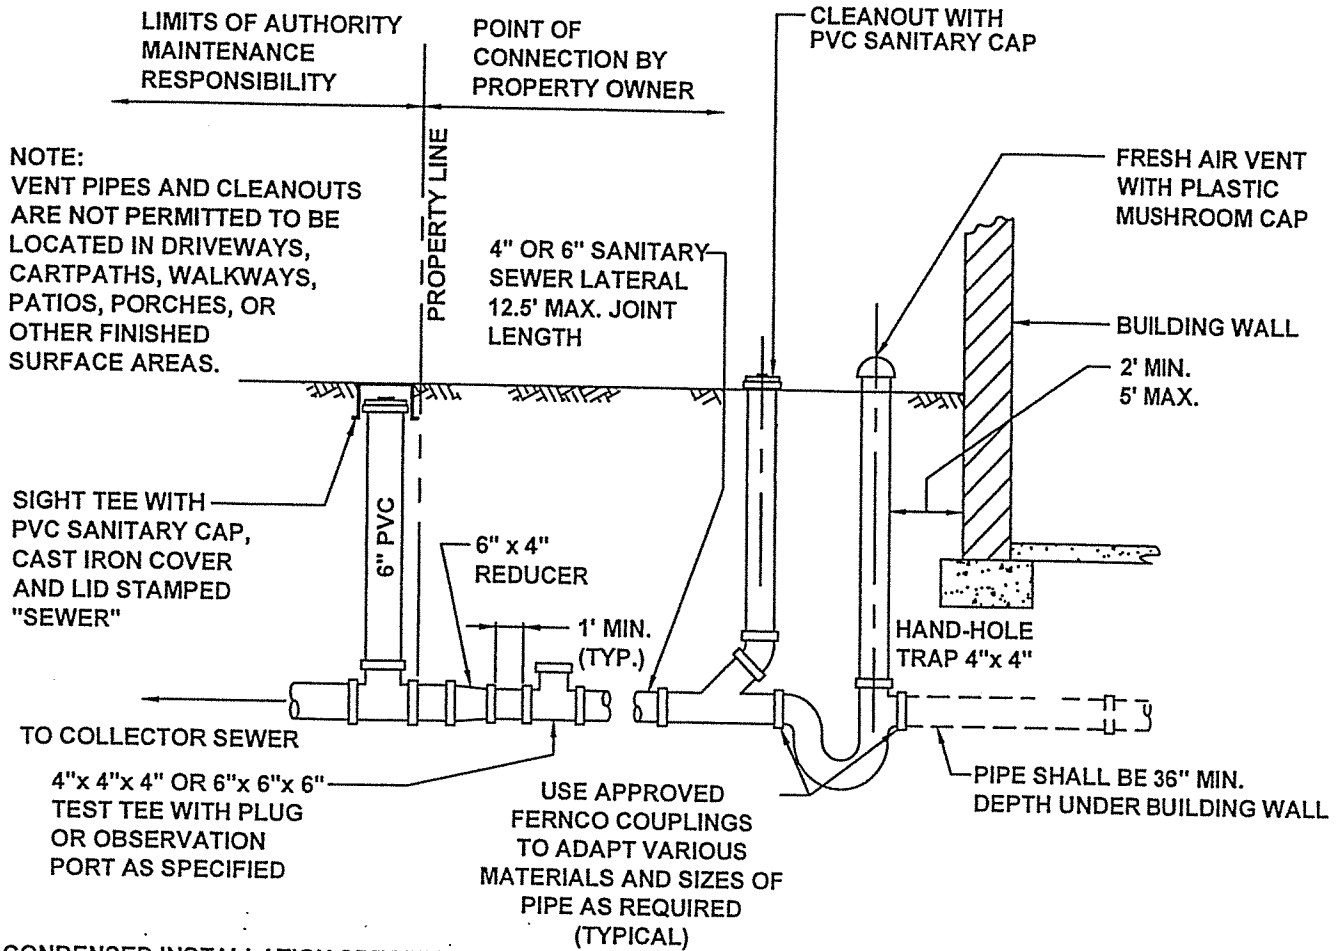

MATERIAL	ASTM SPECIFICATIONS JOINT			ASTM SPEC.
4" PVC	D-1875	SCH-40	SOLVENT WELD	D-2564
6" PVC	D-3034	SDR-35	ELASTOMERIC	D-3212

ROSTRAVER TOWNSHIP SEWAGE AUTHORITY 1744 Rostraver Road Belle Vernon, PA 15012		SERVICE CONNECTION TO SANITARY SEWER LATERAL FROM A NEW INSTALLATION
Not to scale	April 2013	Standard Detail SD-028